



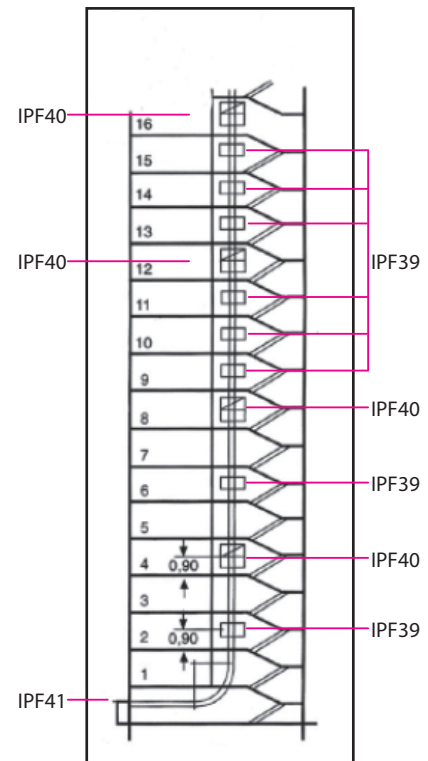

DRY PIPE

Is a vertical pipe (3") with water inlets in different floors of the building, exclusive use of fire brigade. It is always without water, except when fire brigade used it to extinguish a fire

The installation is made in accordance with the R/D 1942/1993.

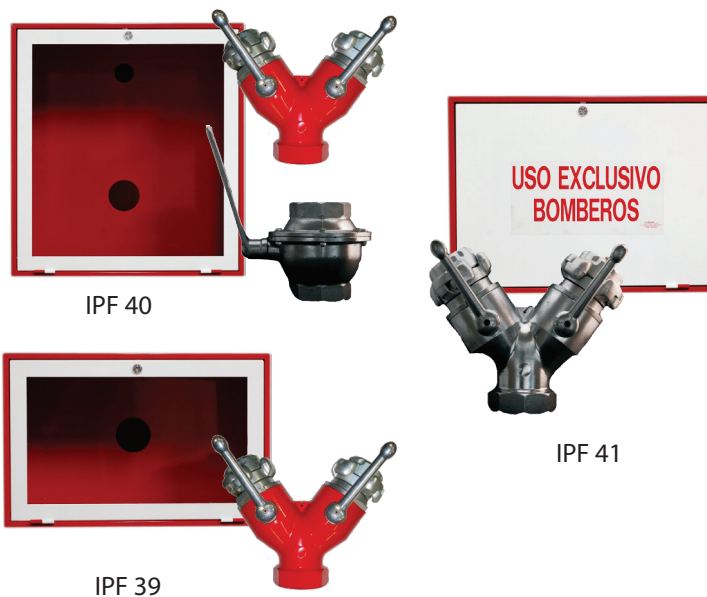

AUTOMATIC SPRINKLERS

The sprinklers are an automatic system of fire control, which are activated because of an increase in temperature produced by a fire. They are controlled by an alarm check valves, which is also responsible for activating the fire alarm.

Temperature and color range (of the bulb):

Red:	68°C
Yellow:	79°C
Green:	93°C
Blue:	141°C
Black:	260°C



* Consult models and configurations